FOR BID ONLY

12 TYP. ANCHOR BOLTS EMBEDMENT — SCALE 1"=1'-0" — 9

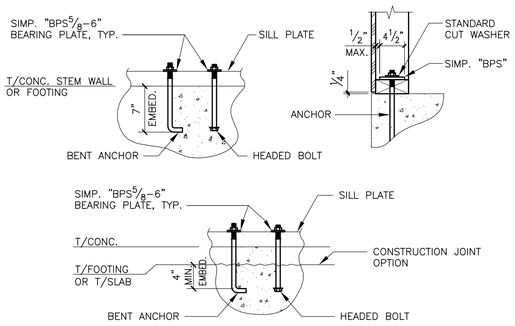

NOTES:
1. PROVIDE A MINIMUM SILL BOLT EMBEDMENT OF 7" BELOW TOP OF CONCRETE.
2. PROVIDE AN ADDITIONAL SILL BOLT 6 INCHES MINIMUM FROM END OF EACH PIECE OF SILL PLATE.
3. WHERE SILL PLATES ARE BORED OR NOTCHED IN EXCESS OF 1/3 OF THE SILL PLATE WIDTH, PROVIDE ADDITIONAL SILL BOLTS 6 INCHES MINIMUM EACH SIDE OF BORE OR NOTCH.
4. SET ALL SILL BOLTS WITH A SETTING TEMPLATE BEFORE PLACING CONCRETE. STABBING OR PUSHING SILL BOLTS INTO WET CONCRETE IS EXPRESSLY PROHIBITED.
5. THE CONTRACTOR MUST COORDINATE & IF NECESSARY DECREASE THE SILL BOLT SPACING SO THAT THE TOTAL NUMBER OF SILL BOLTS REQ'D. ARE INSTALLED IN ALL SHEARWALL SILL PLATES (IE: IN A 4' SHEARWALL W/SILL BOLTS SPACED @ 16"O.C. & 9" OFF EA. END THERE SHOULD BE 48/16+1=4 SILL BOLT ANCHORS), TYP.
6. STANDARD HOOKED ANCHOR BOLTS OF THE SAME SIZE & SPACING MAY BE SUBSTITUTED IN PLACE OF HEADED BOLTS.

TYP. PERIMETER FTG. — SCALE 1"=1'-0" — 6

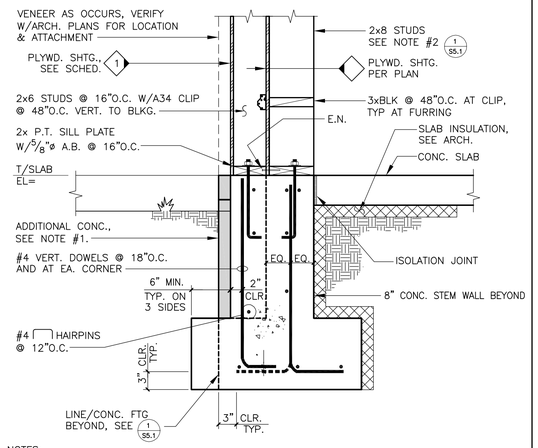

NOTES:
1. ADDITIONAL CONCRETE FOR VENEER SUPPORT AS REQUIRED, PLACE CONCRETE MONOLITHICALLY WITH FOOTING AND STEM WALL, COORDINATE TOP OF CONCRETE WITH ARCH. DWGS.
2. FOR INFORMATION NOT NOTED, SEE 1/S5.1

TYP. PERIMETER FTG. AT POP-OUT — SCALE 1"=1'-0" — 3

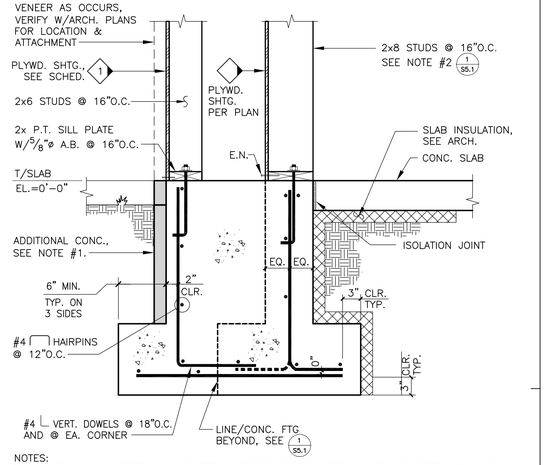

NOTES:
1. ADDITIONAL CONCRETE FOR VENEER SUPPORT AS REQUIRED, PLACE CONCRETE MONOLITHICALLY WITH FOOTING AND STEM WALL, COORDINATE TOP OF CONCRETE WITH ARCH. DWGS.
2. FOR INFORMATION NOT NOTED, SEE 1/S5.1

11 HOLDOWN DETAIL — SCALE 1"=1'-0" — 8

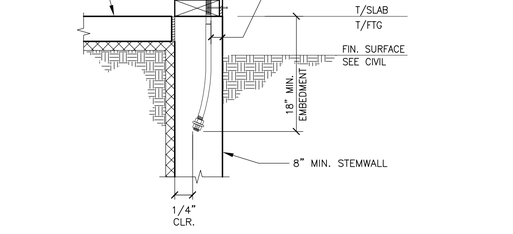

TYP. PERIMETER FTG. AT OPNG. — SCALE 1"=1'-0" — 5

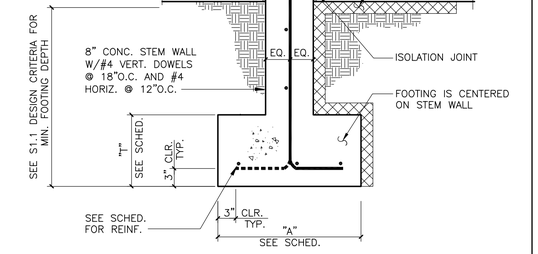

TYP. PERIMETER FTG. AT POST — SCALE 1"=1'-0" — 2

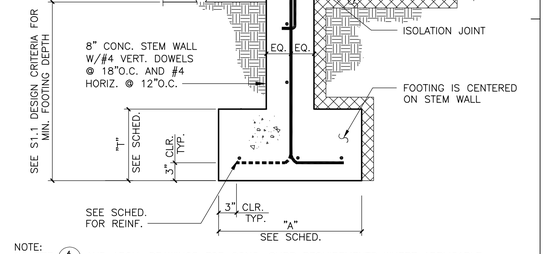

NOTE:
1. SEE 4/S5.1 AND ARCH. DRAWINGS FOR CONC. CURB REQUIREMENTS WHERE APPLICABLE.

10 HOLDOWN DETAIL — SCALE 1"=1'-0" — 7

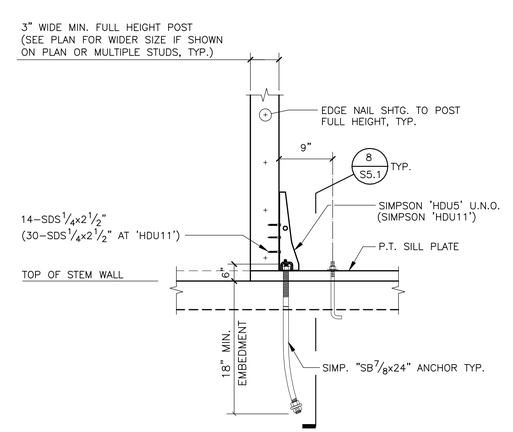

NOTES:
1. "SB" ANCHOR BOLTS ARE FOR CONCRETE APPLICATIONS POURED MONOLITHICALLY, TYP.

TYP. PERIMETER FOOTING W/CURB — SCALE 1"=1'-0" — 4

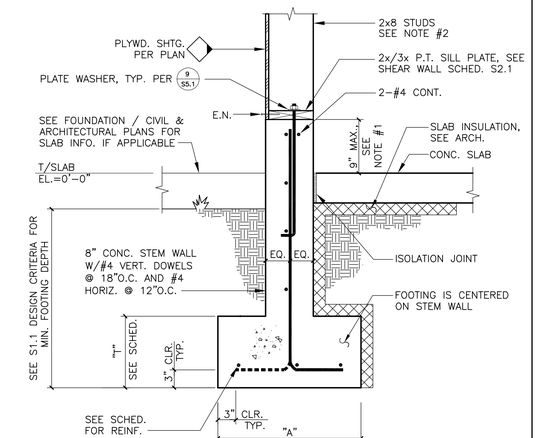

NOTE:
1. SEE ARCHITECTURAL PLANS FOR MORE INFORMATION AND LOCATION.
2. 2-2x8 STUDS EA. TRUSS (32"O.C.) 2x8 STUDS BETWEEN

TYP. PERIMETER FOOTING — SCALE 1"=1'-0" — 1

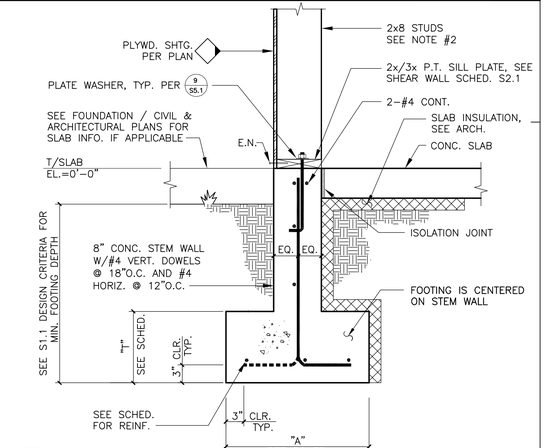

NOTE:
1. SEE 4/S5.1 AND ARCH. DRAWINGS FOR CONC. CURB REQUIREMENTS WHERE APPLICABLE.
2. 2-2x8 STUDS AT TRUSS (32"O.C.) 2x8 STUDS BETWEEN

GreenbergFarrow
1430 W. Peachtree St., Suite 200
Atlanta, GA 30309
t: 404 601 4000 f: 404 601 3980

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the Professional

ISSUE/REVISION RECORD

DATE	DESCRIPTION
02/13/15	PERMIT SET

BARRY LEVIN & ASSOCIATES
STRUCTURAL ENGINEERS
301 PERIMETER CENTER NORTH
SUITE 100 · ATLANTA, GEORGIA 30346
PHONE 770-457-2076 · FAX 770-457-9514
WWW.BARRYLEVIN.COM

PROFESSIONAL SEAL

BARRY LEVIN NEW MEXICO 12067 REGISTERED PROFESSIONAL ENGINEER

PROFESSIONAL IN CHARGE
BARRY LEVIN
PROJECT MANAGER
R NEW
QUALITY CONTROL
R NEW
DRAWN BY
J MITCHELL

PROJECT NAME
CIRCLE K STORES, INC.

ALBUQUERQUE
NEW MEXICO

4400 COORS BLVD. SW
ALBUQUERQUE, NM 87121

CIRCLE K STORES INC.

PROJECT NUMBER
2014-067

SHEET TITLE
SECTIONS & DETAILS

SHEET NUMBER
S5.1-CS

CIRCLE K SOUTHWEST PROTOTYPE 4480 - 09/13/2013

Drawing Name: C:\Revit Workspace\JOB\2014-067\2014-067 Circle K - Albuquerque, NM (Standard) (BLA Overrides)(Working)Sheets\2014-067 Circle K Albuquerque, NM - Store - S5.1.rvt, Last Modified: Feb 13, 2015 - 3:12pm, Plotted on: Feb 13, 2015 - 4:30pm, By: tmgarry